



IAEA Workshop - Research Reactors

Implementation of the post-Fukushima Daiichi accident Enhancement Programme for RRs

Sydney - December 2017

**French Nuclear Safety Authority
mickael.gandolin@asn.fr**



Presentation


1. Regulatory Programme
2. Review and Assessment
3. Regulatory Requirements



ASN immediate actions

- Campaign of targeted inspections
- “Stress test” safety analysis of nuclear facilities
 - Complies with the European Council conclusions (March 2011)
 - Applies to 150 nuclear installations in France (58 NPP, NPP under construction, fuel cycle facilities, research reactors, etc.)
 - Covers:
 - extreme natural events (earthquake, flooding,...)
 - loss of the ultimate heat sink or loss of electrical power
 - severe accident management
 - Is complementary to existing safety improvement processes
 - Periodic Safety Reviews (PSRs)
 - integration of Operating Experience Feedback

- Priorization is needed for CSA :

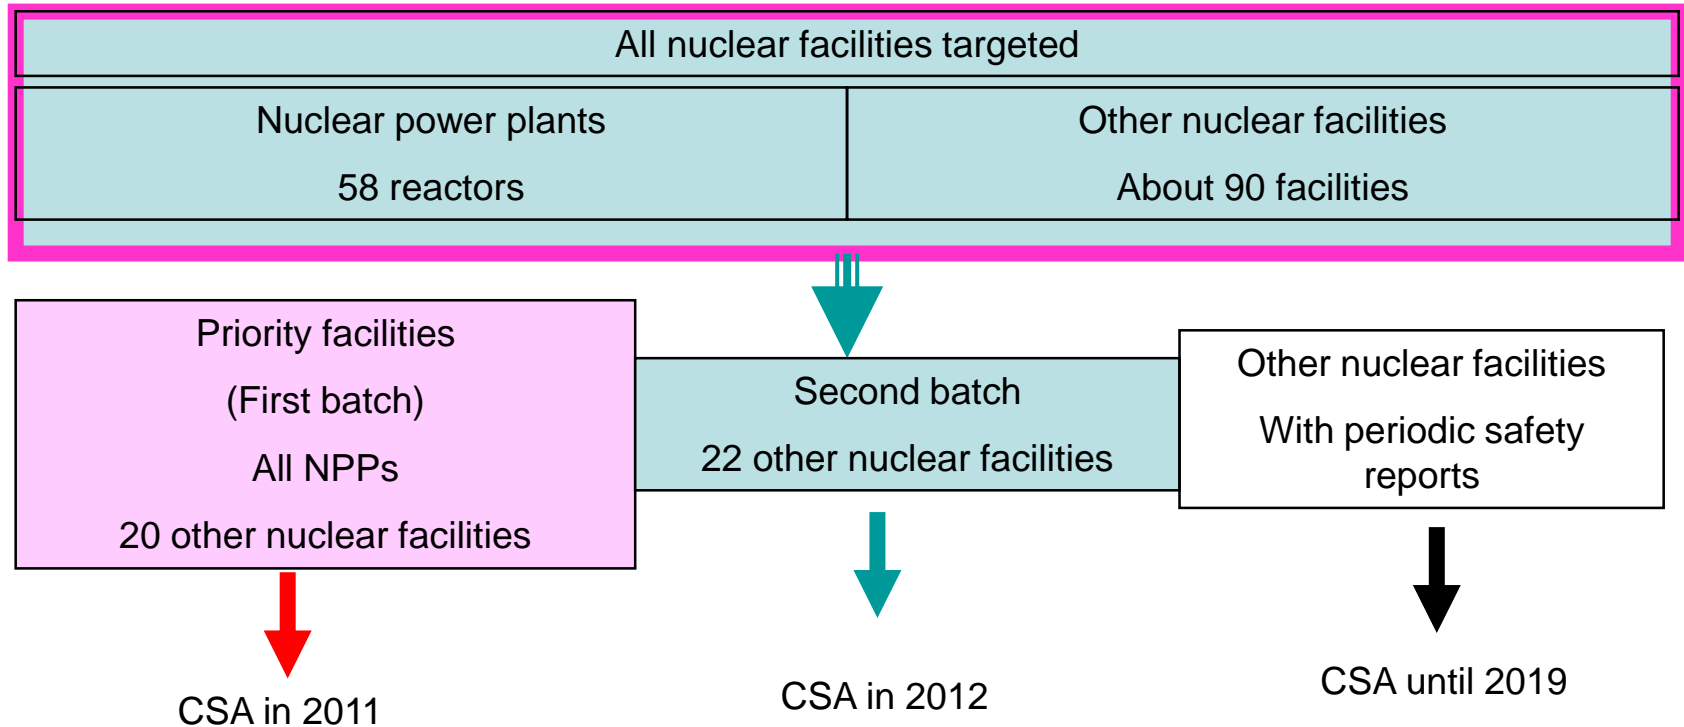

- Classification taking in account :

- Type of facility : nuclear reactors → thermal power
- Amount of radioactive material and hazardous substances
- Potential off-site releases
- Robustness and independence of the containment barriers



French Research Reactors

(Critical mock-up, neutron beam supplier reactor, safety test reactor, prototype or technological irradiation reactor, teaching reactor)



Site approach :
CEA Cadarache Site
CEA Marcoule Site
CEA Saclay Site

CEA Research Reactors

Cadarache Site

- RÉACTEUR JULES HOROWITZ** - Technological irradiation reactor – 1st batch – *in construction*
- Masurca** - Critical mock-up – 1st batch – *currently stopped*
- Rapsodie** - RR for the SFR line – 2nd batch - *decommissioning*
- CABRI** – Safety tests reactor – 2nd batch
- Eole/Minerve** – Critical mock-up - 3rd batch
- Phébus** - Severe accident studies reactor - 3rd batch - *currently stopped*

Marcoule Site

- PHENIX** - Sodium-cooled Fast Reactor (SFR) Prototype – 1st batch – *currently stopped*

Saclay Site




- OSIRIS** - Technological irradiation reactor - 1st batch - *currently stopped*
- ORPHEE** - Neutron beam reactor - 2nd batch
- ISIS** - Teaching reactor – 3rd batch

- Laue-Langevin Institute RR**
High Flux Reactor (HFR) - Neutron beam reactor – 1st batch



Complementary Safety Assessment (*Batch 1*)

- May 5th 2011: **ASN decisions** defining the requirements specifications of the assessment:
 - Based on the WENRA and ENSREG workshop from March to May
- September 15th 2011: **Licensees' Report**
- September - December 2011: **Technical review**
 - **TSO Review & Assessment reports**
 - Advisory committees of experts
 - Participations of several stakeholders (high committee for transparency and information of nuclear safety, local information committee, NGO, international experts,...)
- January 3rd 2012: **ASN Report**
- June 26th 2012: **ASN decisions** requiring safety improvements to the **batch 1 of nuclear installations**

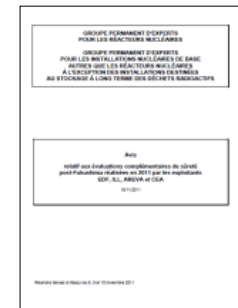






ASN's opinion on the CSA issued in January 2012

- ASN made public its report on the CSA carried out for the priority facilities in 2011
- ASN considers that
 - *the facilities offer a sufficient level of safety, so that ASN doesn't request the immediate shutdown of any of them*
 - *At the same time, for the continuation of their operation, an increase of the robustness of the facilities to extreme situations beyond their existing safety margins is necessary, as rapidly as possible*
- ASN has therefore required that the licensees take measures and reinforce the safety requirements related to natural hazards (earthquake and flooding)
- ASN considers that the complete analysis of the feedback of the accident could take up to 10 years



Complementary Safety Assessment (*Batches 1 & 2*)

- June 2012 - March 2013: **AREVA & CEA complementary assessment to define a post-Fukushima set of safety features**
- April 2013 **Batch 1: Technical review**
 - TSO Review & Assessment reports
 - Advisory committees of experts
- July 2013 **batch 2: Technical review**
 - TSO Review & Assessment reports
 - Advisory committees of experts
- January 8th 2015 : 14 **complementary ASN decisions** defining additional safety requirements to define and implement *Hardened Safety Core* arrangements for the **AREVA & CEA nuclear facilities**

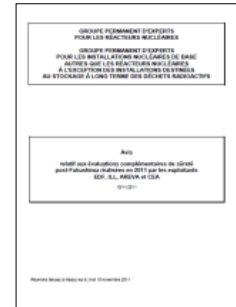



2. Review and Assessment





Review and Assessment

3 issues

Graded approach

Engineering judgement

Hazards




Losses of functions



Severe accident

- Robustness against hazards
- Robustness against loss of heat sink and loss of electrical supplies
- Robustness of the arrangements to manage a severe accident and an emergency

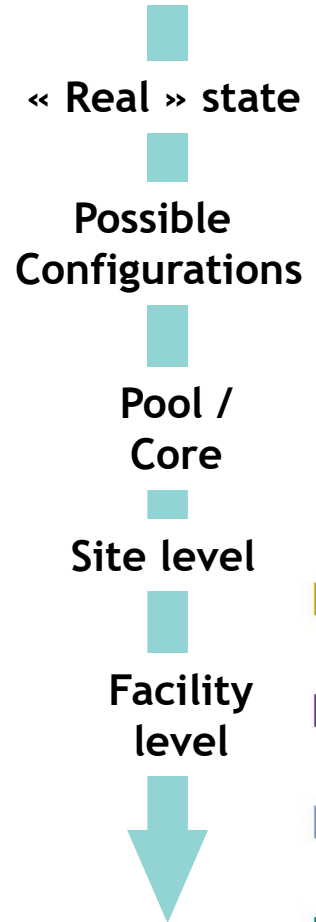

- No major gaps in the safety cases ; some non-compliances with design requirements and [AUT]
- Need to define a complementary approach with extreme natural hazards and large accident scenarios (duration, number of facilities...)




Review and Assessment

Safety arrangements to manage more and more serious situation

Hardened safety core features should be protected from hazard generated by the Accident (fire, explosion, drops loads...)

Hardened safety core (limited number of features)

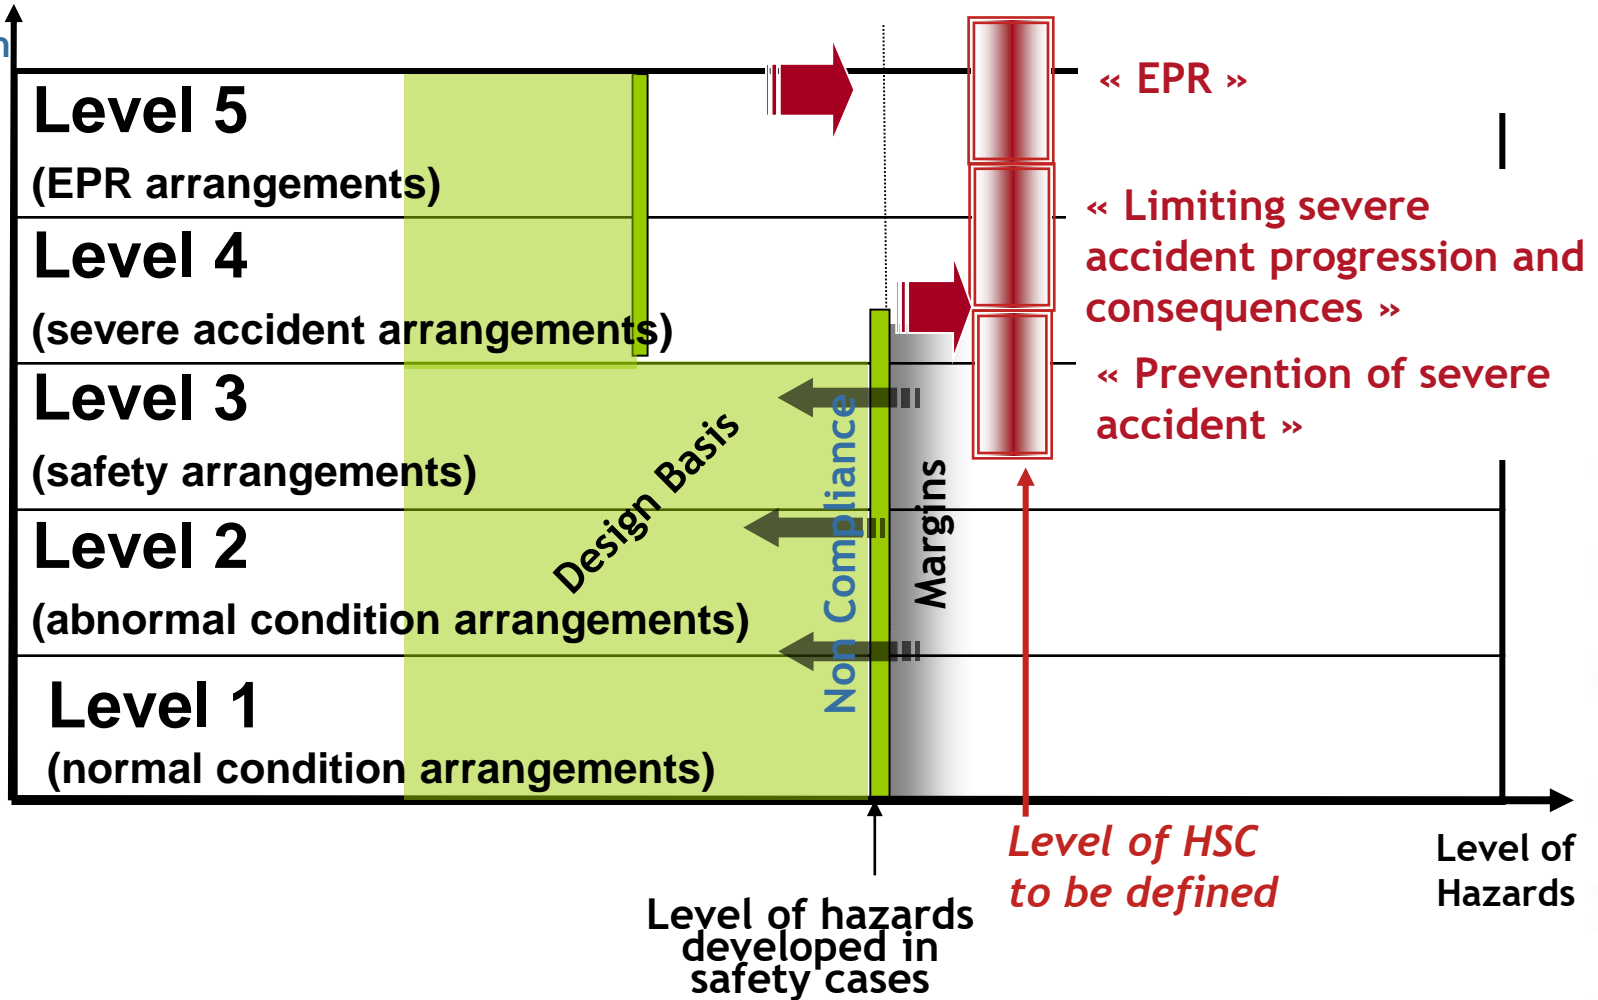



3. Regulatory Requirements





26th June 2012: ASN resolutions the hardened safety core (1/3)

- ASN requirement : safety goals for the *Hardened Safety Core* for the situations considered in the stress tests
 - To prevent or mitigate the progress of a severe accident
 - To mitigate large-scale radioactive releases
 - To enable the Operator to perform its emergency management duties
- System, structure and components (SSCs)
 - **designed with significant margins** in relation to the requirements currently applicable
 - composed of **independent and diversified SSCs**. The licensee shall justify the use of undiversified or existing SSCs
- Emergency arrangements
 - **Emergency Control Room** with greater resistance to hazards and being accessible and habitable at all times and during long-duration emergencies

Same as NPP


Same as NPP

Same as NPP



- Emergency Preparedness
 - To develop a **site approach** considering accidents in several facilities
- CSA complements
 - To assess identified cases of accident specified by ASN “**Feared situations**”
- ASN requirements to each BNI
 - Following the CSA, to define additional arrangements to cover :
 - loss of cooling
 - loss of electrical supply
 - **Internal & external hazards**

- Example of a “Site approach” with several installations :
✓ CEA Cadarache site

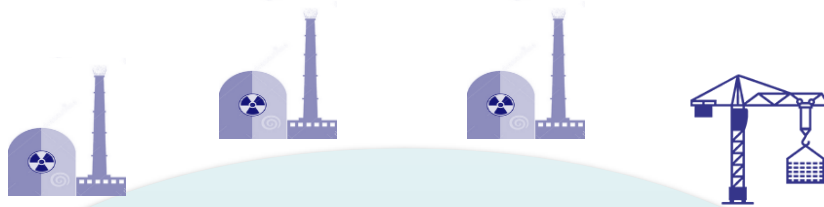

16 BNI (RRs, Waste facilities...)

1 Defense nuclear installation

35 Chemical Plants, classified for industrial hazards and environment protection

4 Decommissioning / 2 Construction



Examples of Site arrangements:

- Complementary studies on fire & explosive hazards for facilities closer than 50m,
- Definition of safe paths for the rescue teams through the site considering the radiological conditions,
- Two additional water tanks seismic qualified on site considering the safe paths.





8th January 2015 : ASN resolutions the hardened safety core (1/3)

- ASN resolutions :
 - ✓ specific for a BNI
 - ✓ specific for a site with several installations but addressed to one Licensee
- The resolution sets more detailed safety goals for the hardened safety core
 - ✓ Level of external hazards (seismic, tornado, T° ...) **Same as NPP**
 - ✓ Extreme Earthquake : Max[> 20 000 years ; 1,5 DBE] + (site effects)
- **The resolutions request the Operator to:**
 - Define the list of SSCs composing the hardened safety core and their qualification requirements
 - ✓ New SSCs designed according to industrial standards
 - ✓ Existing SSCs verified according to industrial standards, or verified according to methods allowed during PSRs

- Emergency Preparedness and Response
 - ✓ Arrangements to ensure the ability of the hardened safety core SSC to work the **first 48hrs without any external support and supplies**
 - ✓ Availability in the Emergency Control Room of **key parameters related to the safety functions** of the facilities (level of water in a pond, T°, ...)
 - ✓ Arrangements to provide **external support** (human resources, additional materials and supplies) to a site affected by an extreme event (similar than the EDF Nuclear Rapid Response Force):
 - AREVA : FINA (*force d'intervention nationale AREVA*)
 - CEA : FARN

Similar to NPP

- Target dates & Licensees' programmes
 - Target dates are settled in the ASN decisions for each BNI and Sites, to provide a trend :
 - ✓ Additional studies → ≈ 2015 - 2016
 - ✓ Additional emergency arrangements → ≈ until 2018
 - ✓ Additional material → ≈ until 2018
 - Target dates could be related to *Periodic Safety Review*

- **Laue Langevin Institute:**

- Private company
- Partnership of 3 countries: UK, Germany, France
- Operate only one BNI




- **High Flux Reactor (HFR) :**

- Power 57 MW th
- Neutron flux used for international scientific experiences
- Fuel : HEU (93%) uranium-aluminium
- First start up in 1971, new autorisation in 1994 due to new Reactor pressure vessel

- **Site :**

- Located in Grenoble
- Mountainous area : seismic risk and several dams in the upper reaches
- Urban area with several companies and research centers (CEA)

- **Loss of electrical supplies and Loss of heat sink**
 - No issue on the core cooling (reactor trip, natural convection)
- **Extreme flooding**
 - Failure of 4 dams on the Drac River, leading to consider an additional (+5,5 meters) to the design basis
- **Extreme Sismic level :**
 - > 20 000 years and 1,5 DBE (site effects)
- **Review of the safety cases:**
 - Safety margins of the existing HSC features
 - New HSC features
 - Potential internal hazards

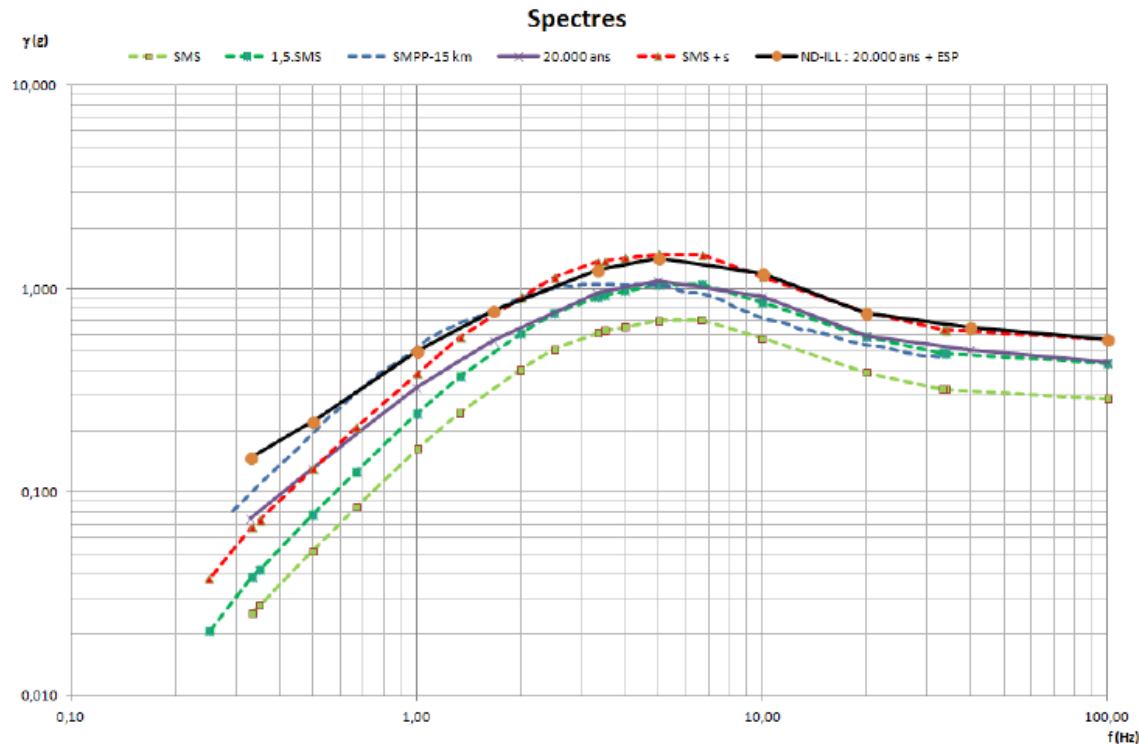




Hardened Safety Core Passive features

- ❑ To prevent core-melt under water
 - ✓ Reactor pressure vessel
 - ✓ Natural convection valves
- ❑ To prevent core-melt in air
 - ✓ Immersion sleeve
 - ✓ Reactor pond and channel 2
 - ✓ transfer basket and handling cask
- ❑ To mitigate core-melt
 - ✓ Concrete reactor containment

Existing systems are examined considering extreme external hazards level

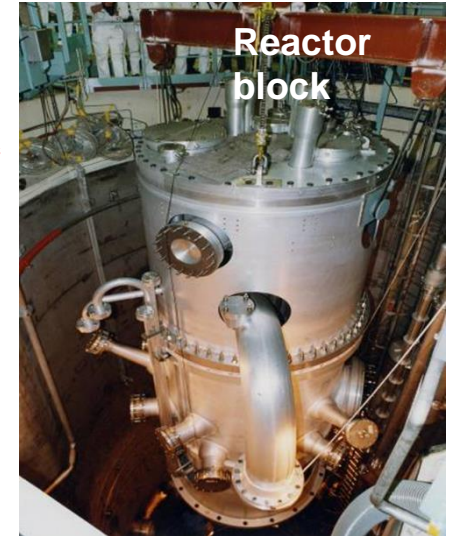



Hardened Safety Core Active systems

❑ To prevent core-melt

- ✓ Earthquake : automatic reactor trip and isolation of the non seismic qualified electrical supplies
- ✓ Ultimate heat sink : 2 files to refill the pool or the channel from the groundwater table (250 m³/h each) (*from 2017*).
- ✓ Ultimate cooling water system : from the pond in the case of a breach in the primary coolant system (untill 400m³/h) with pyrotechnic valves

❑ To mitigate core-melt

- ✓ Containment vessel isolation system : seismic qualified
- ✓ Seismic containment depressurised system (CDS) : to maintain the reactor building depressurised and to filter the releases to the environment

❑ Bunkerised emergency control room

- ✓ Redundant electric supply, key plant and environment parameters survey, ability to operate safety systems





Conclusion

- The implementation of the HSC features prescribed by ASN resolutions
- With ambitious deadline which are mainly in compliance with the regulatory programme
- Some difficulties to build the new Bunkerised Emergency Control Room buildings which could have lead to delay.



Thank you for your attention